

Ritorno® Round Asymmetrical

selux



Project: _____

Type: _____ **Qty:** _____

RRA - - - - -
 Series Mounting Height Lamping Lamp Color Finish Voltage


Options

LAMPS SUPPLIED WITH FIXTURE EXCEPT FOR NOL OPTION.

Series	Mounting	Height	Lamping	Lamp Color	Finish	Voltage	Options
RRA Ritorno® Round Asymmetrical	1 Single W Wall Mount	RP10 10 ft.	Metal Halide	NOL No Lamp Supplied	WH White BK Black BZ Bronze SV Silver SP Specify Premium Color	120 208 240 277 347	REC GFCI Receptacle (pole mount only) FS ¹ Single Fusing Consult factory for other options.
		RP12 12 ft.	H050 50w	830 3000° K			
		RP14 14 ft.	H070 70w	940 4000° K			
		RP16 16 ft.	H100 100w H150 150w				
			T6 Metal Halide	NOL No Lamp Supplied			
			H070T6 ² 70w	830 3000° K			
			H150T6 150w	942 4200° K			
			HPS	NOL No Lamp Supplied			
			S050 ² 50w	221 2100° K			
			S070 70w				
			S100 100w				
			S150 150w				
			QL Induction	830 3000° K			
			QL85 ¹ 85w	840 4000° K			
			QL165 ¹ 165w	850 5000° K			

¹ Not available with 347v ² Not available with 240V/208V



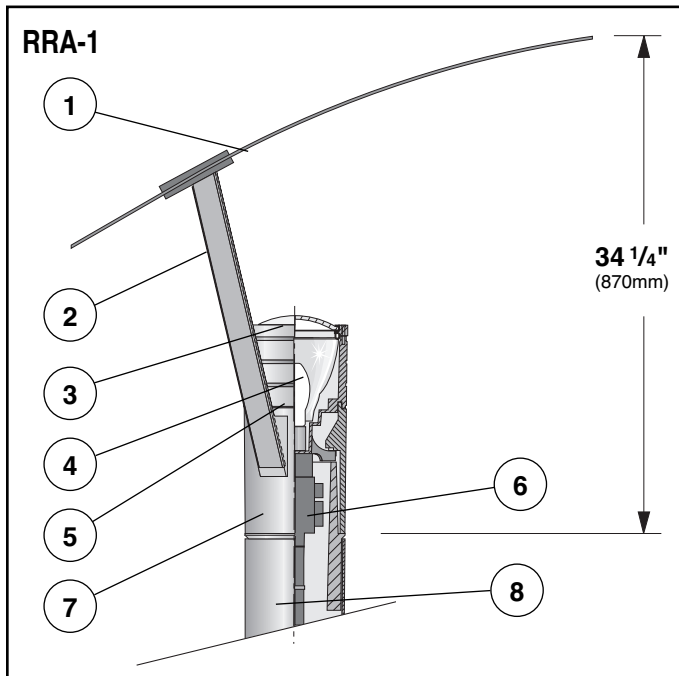

- 1. Reflective Shade** - 36³/₄" x 35" (934mm x 889mm) minimum 3/16" (4.7mm) thick aluminum reflector shade painted white for maximum reflectivity. Supplied with drip groove around perimeter, to prevent rain marks on underside. Shade attached to fixture arms with low profile stainless steel hardware.
- 2. Fixture Arms** - Two natural, marine grade stainless steel with

bead-blasted finish, rigidly attach reflector shade to pole fitter.

- 3. Lamp Cover** - Heat-tempered convex lens protects lamp and reflector assembly. Continuous molded silicone gasket creates sealed optic chamber for weather proofing, dust and insect control. Door pivots open from lamp chamber for relamping. Three captive stainless steel screws secure lamp cover in position

- 4. Lamp** - One coated, base down, medium base ED-17 metal halide or high pressure sodium up to 150w; 70w or 150w ceramic G12 base T6 metal halide (830 - 3000 K), or 85w or 165w QL induction lamp (840 - 4000 K). Other lamps/colors available, consult factory. Lamp supplied with fixture unless otherwise specified.

- 5. Optic Chamber** - Die cast aluminum optic chamber houses highly specular precision reflector & 4KV pulse rated medium base socket and lamp. Secures to pole fitter with quarter turn mechanism, locked in place with a single screw. Optic chamber is removable from pole fitter for ballast access, without the necessity of removing the fixture head from the pole.

- 6. Ballast** - A high efficiency, pulse start, core and coil ballast factory wired to socket. Remov-able ballast bracket is secured to optic chamber for ease of maintenance. Consult factory for more detailed ballast information.

- 7. Pole Fitter** - Die cast aluminum fitter secures fixture arms and reflective shade to pole. Tapered to continue lines from pole.

- 8. Pole** - Pole to be aluminum and taper from 5" diameter at the bottom to 7" diameter at the top. Pole wall thickness to be minimum 0.156 thick, supplied with a 3" x 5" hand hole, with cast 356 aluminum tempered to a T6 condition reinforced frame, with integral ground lug con-

nection and gasketed flush fitting door.

- 9. Base Cover** - (not shown) Standard two-piece base cover is made from die-cast 356 alloy aluminum which is heat treated to produce a T6 temper, measuring 4¹/₂" (115mm) height by 12¹/₂" (316mm) diameter.

Exterior Luminaire Finish - Selux utilizes a high quality Polyester Powder Coating. All Selux luminaires and poles are finished in our Tiger Drylac certified facility and undergo a five stage intensive pretreatment process where product is thoroughly cleaned, phosphated and sealed. Selux powder coated products provide excellent salt and humidity resistance as well as ultra violet resistance for color retention. All products are tested in accordance with test specifications for coatings from ASTM and PCI.

Standard exterior colors are White (WH), Black (BK), Bronze (BZ), and Silver (SV). Selux premium colors (SP) are available, please specify from your Selux color selection guide.



Photometry

150w MH

Catalog # RRA-1-H150
Report # ITL-14364

- Maximum candela of 1931 at 52.5° from vertical.
- IES classification = Type IV Non-Cutoff.

DOWNLOAD IES FILE:
http://www.selux.us/fileadmin/us/exterior/ies_file/RRA_IES.zip

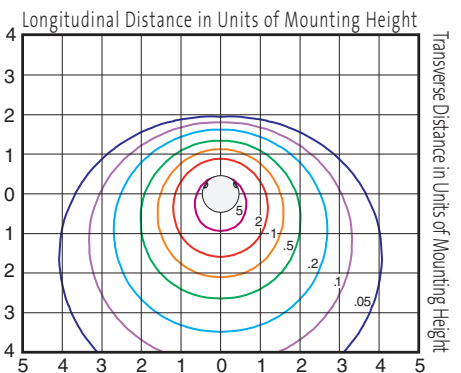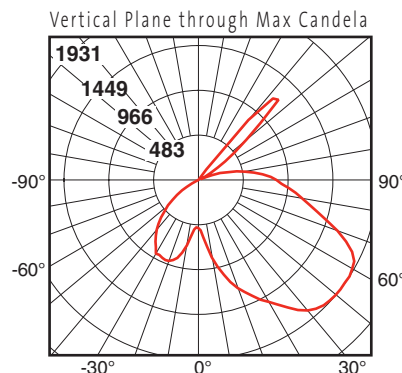


HID Lamp Prorate Table					
High Pressure Sodium			Metal Halide		
Wattage	Factor	Initial Lumens	Wattage	Factor	Initial Lumens
50	0.29	3800	50	0.30	4000
70	0.45	5950	70	0.45	6000
100	0.66	8800	100	0.68	9000
150	1.12	15000	150	1.00	13300


Conversion Chart	
Values based on 12' mounting height.	
Mounting Height	Multiply
10'	1.10
12'	1.00
14'	0.93
16'	0.87

Mounting


Single

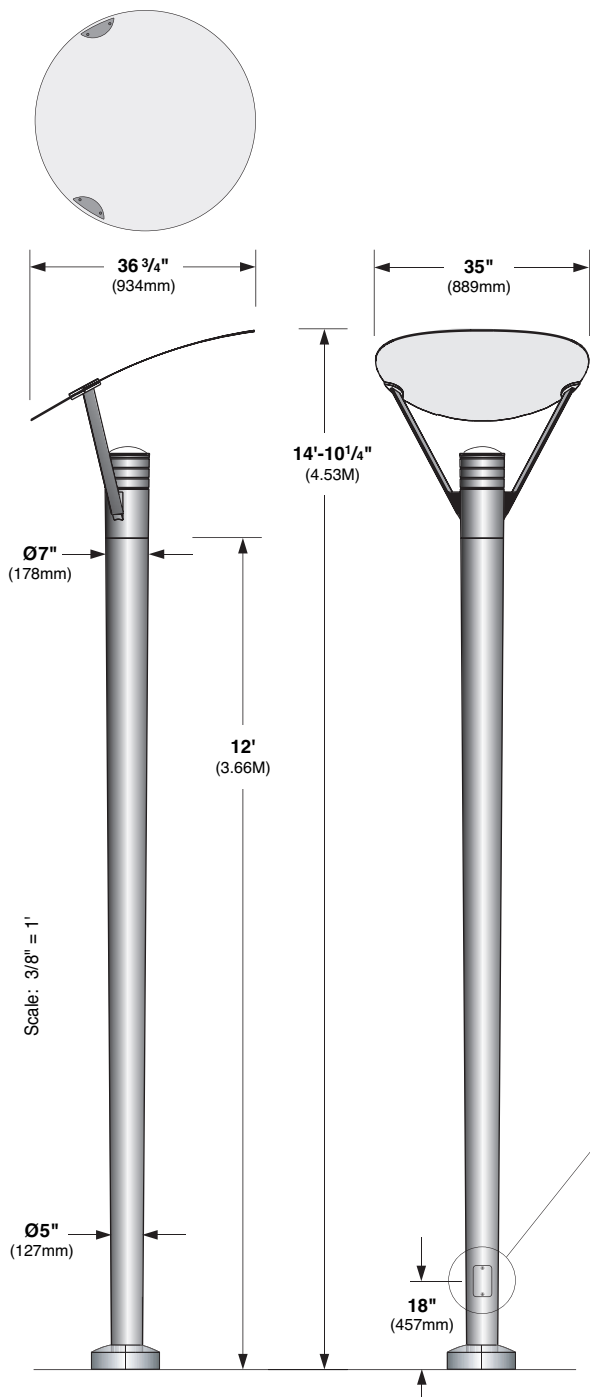

Wall Mount

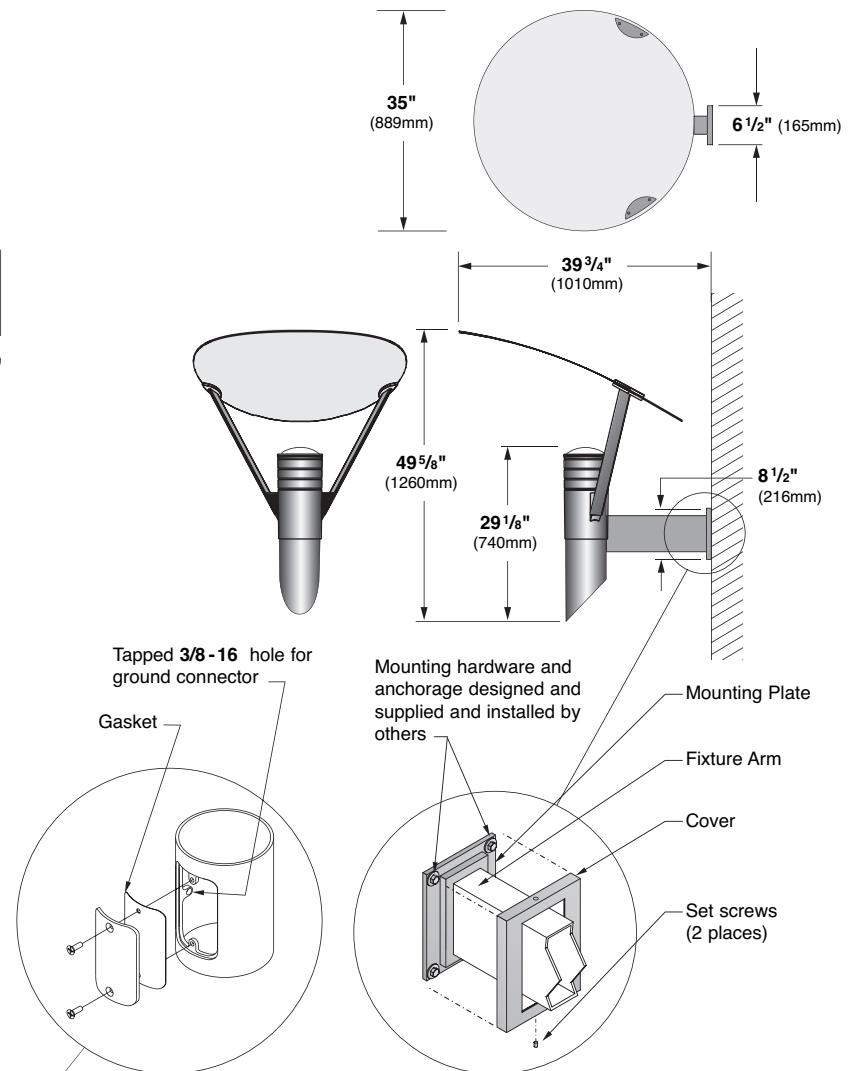


Wall Mounting Plate Detail

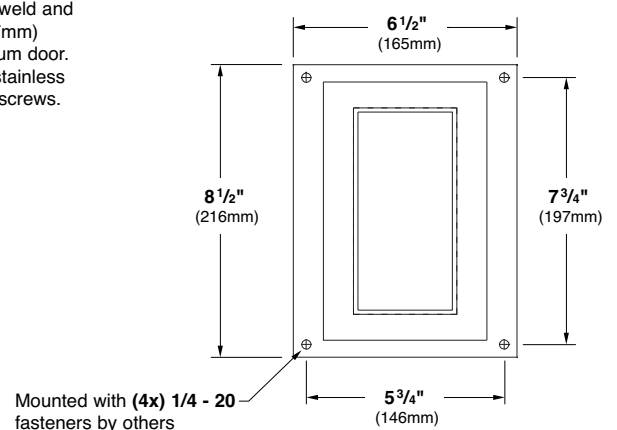

Effective Projected Area of Single Luminaire = 4.4 ft² (408m²)
Weight of Luminaire = 60.0 lbs (27.3kg) Pole and luminaire engineered to withstand 120mph wind (+1.3 gust) as per AASHTO standards. See next page for Reverse Taper Pole EPA information.


Bolt Circle

Use caution when setting anchor bolts. Bolts must be vertically straight and centered on dimensions shown.

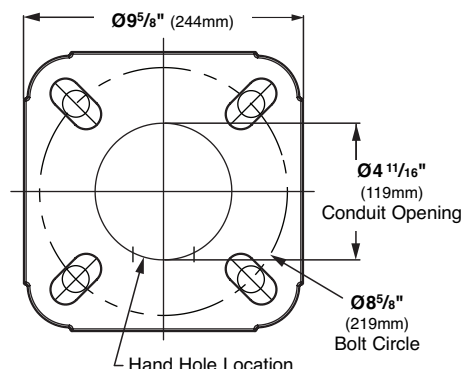


Note: Adequate drainage must be provided in concrete foundation.

Anchor Bolt Detail

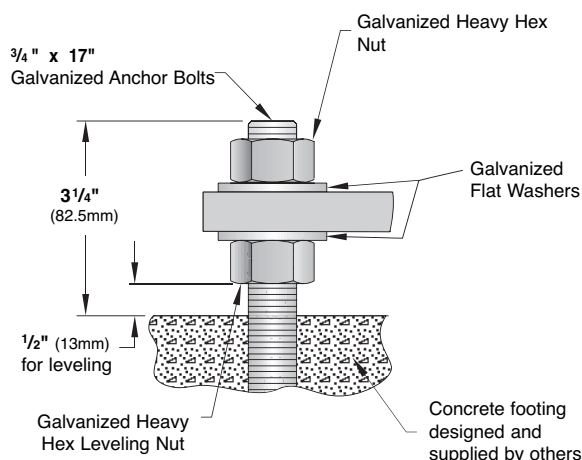


BC3 Standard Base Cover

Die-cast aluminum, two-piece field installable base cover.

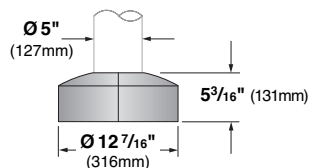


Alternate Mounting Detail

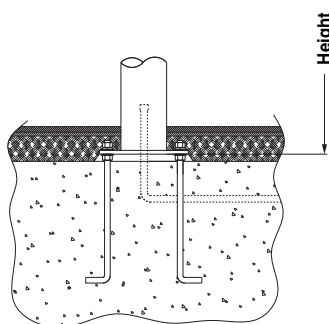

Options

GFCI Receptacle (REC) - GFCI duplex receptacle with cast base welded to pole and gasketed, provided with weather-proof, self-closing cover; located 36" (915mm) from base of pole, inline with handhole. Receptacle is intended only for portable tools or other portable equipment to be connected to outlet only when attended by operating personnel.

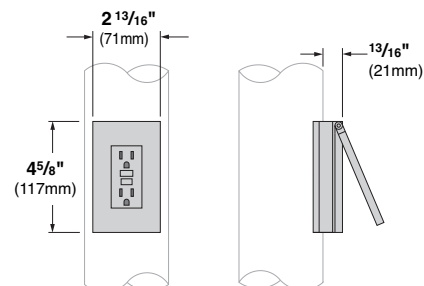

Ritorno Reverse Taper Pole (5" to 7")

EPA values calculated as per AASHTO LTS4 2001, to include fixture. Consult factory for heights other than 12'.

Pole Height	Windspeed					
	70	80	90	100	110	120
10'	16.70	12.34	9.31	7.19	5.62	4.42
12'	13.60	9.86	7.27	5.46		
14'	10.13	7.06	5.02			
16'	8.25	5.53				

All Poles are constructed per AASHTO standards for structural supports for highway signs, luminaires and traffic signals as published in 1975, amended and adopted in 1985 and 1994.

A consideration of field conditions such as (but not limited to) wind zone, height, vibration must be given by the designer/specifier for the appropriate application.

Performance of poles is dependent upon proper support/attachment of pole to adequate foundation design. Selux does not design or offer recommendations for foundations. EPA values assume that the bottom of the pole is at grade level.

Call Selux (1-800-SELUXCS) if there are any questions, or for any assistance in determining suitability with appropriate fixtures.