

M60 Recessed Linear Fluorescent Spackle Flange




Project: _____ **Type:** _____ **Qty:** _____

M60	_____	_____	_____	_____	_____	_____	_____
Series	Lamping	Shielding	Mounting	Nominal Length	Finish	Voltage	Option
Option	Option	Option	Option	Option	Option	Option	Option

Fixture Series	Lamp Type	Shielding	Mounting	Nominal Length	Finish	Voltage	Options
M60 M60 Recessed Multi-Mount Form	1T5 F28T5	SD Satine Lens	SF1 Spackle Flange (1/2" dry wall)	004 4 foot	WH White	120	(qty)EM Stand-by Battery Pack ¹ (prefix quantity, i.e. - 5EM) FS Single Fusing DM Dimming ¹ (specify system) DMA Digital Addressable Dimming ¹ FW Flex Whip (standard) FW1 Flex Whip (dimming) Track Eutrac Standard ² DL Suitable for Damp Locations CCEA Chicago Plenum Downlights
	1T5HO F54T5HO	OD Extra Diffuse Lens	SF2 Spackle Flange (5/8" dry wall)	008 8 foot 012 12 foot For actual lengths see following page. For other lengths, configurations indicate nominal length rounded to the next highest foot. Factory will supply layout drawings. Individual fixtures cannot be field joined.	BK Black SV Silver SP Specify Premium Color	277 347	

¹Must be low profile ballasts (1 3/8" W x 1 3/16" H); consult factory for details. ²Consult factory for details.

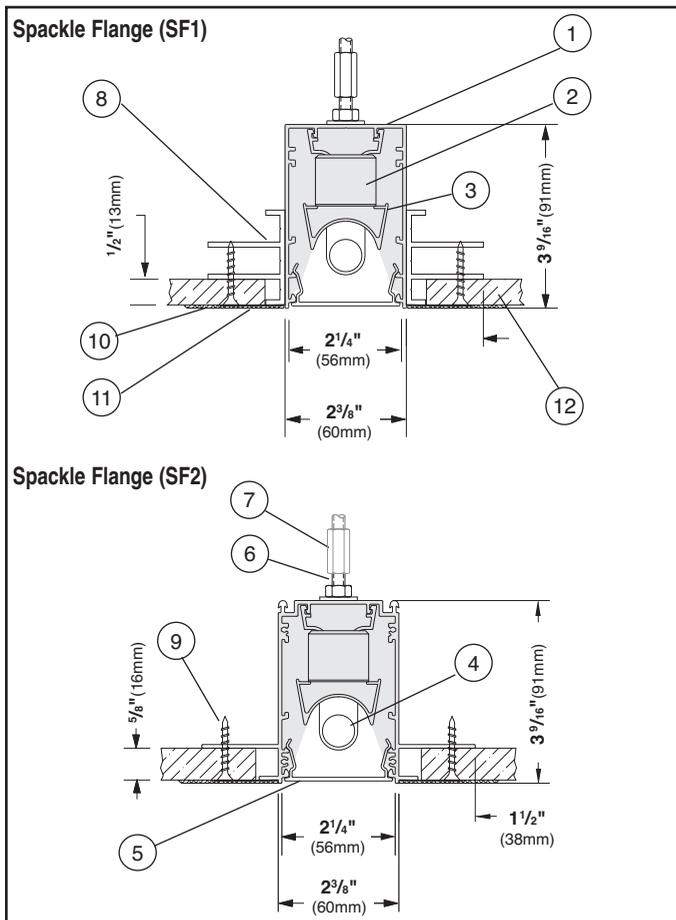

1. Housing - Continuous, 6063-T5 extruded aluminum profile up to 16 feet long.

2. Ballast - Electronic, high power factor, class "P", type "A" sound rating. Specify 120v, 277v, or 347v. Ballast is factory pre-wired with leads to one end of fixture. Consult factory for ballast options.

3. Gear Tray - Die formed gear tray with integral factory preset sliding covers to fill extrusion with light, with a matte white finish for even illumination. Geartray installs as complete electrical unit and is held in place with knurled dress nuts. It is fully accessible from below ceiling.

4. Lamps - As noted (by others). Other lamp lengths or wattages available, consult factory.

5. Shielding - Extruded, impact resistant acrylic snap in lens: Extra diffuse (OD) or satine (SD).

6. Pre-installed 1" 1/4-20 Stud - Attached to fixture every nominal 4 feet.

7. Coupling and Threaded Rod to Structure - Supplied and installed by others.

8. Spackle Flange - For 1/2" (SF1) or 5/8" (SF2) thick sheet rock, installed at factory. Fixtures must be installed before sheetrock.

9. Dry Wall Screw - Supplied and installed by others.

10. Fiberglass Sheetrock Tape - Supplied and installed by others.

11. Plaster Skimcoat 1/16" - Supplied and installed by others.

12. Plaster Board - Supplied and installed by others. For 1/2" thick specify SF1; for 5/8" thick specify SF2.

Interior Luminaire Finish - Interior Luminaire Finish - Selux utilizes a high quality Polyester Powder Coating. All Selux luminaires are finished in our Tiger Drylac certified facility and undergo a five stage intensive pretreatment process where product is thoroughly cleaned, phosphated, and sealed. Selux powder coated products provide excellent salt and humidity resistance as well as ultra violet resistance for color retention. All products are tested in accordance with test specifications for coatings from ASTM and PCI.

Standard interior colors are White (WH), Black (BK), Bronze (BZ), and Silver (SV). Selux premium colors (SP) are available, please specify from your Selux color selection guide.

Selux Corp. © 2018
 TEL: (845)-834-1400
 FAX: (845)-834-1401
 www.selux.us
 M60SF-0118-01(ss-v5.65)

NRTL Listed (i.e. UL, CSA)


Union Made Affiliated
 with IBEW Local 363

In a continuing effort to offer the best product possible, we reserve the right to change, without notice, specifications or materials that in our opinion will not alter the function of the product. Specification sheets found at www.selux.us are the most recent versions and supercede all other printed or electronic versions.


M60 Spackle Flange Layout Dimensions

Nominal 4 foot Individual


Typical End View (all lengths)

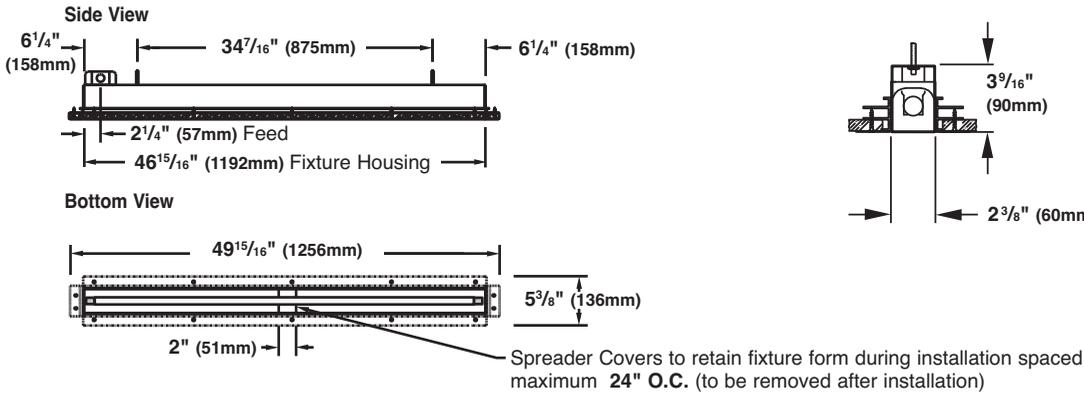

Nominal 8 foot Individual

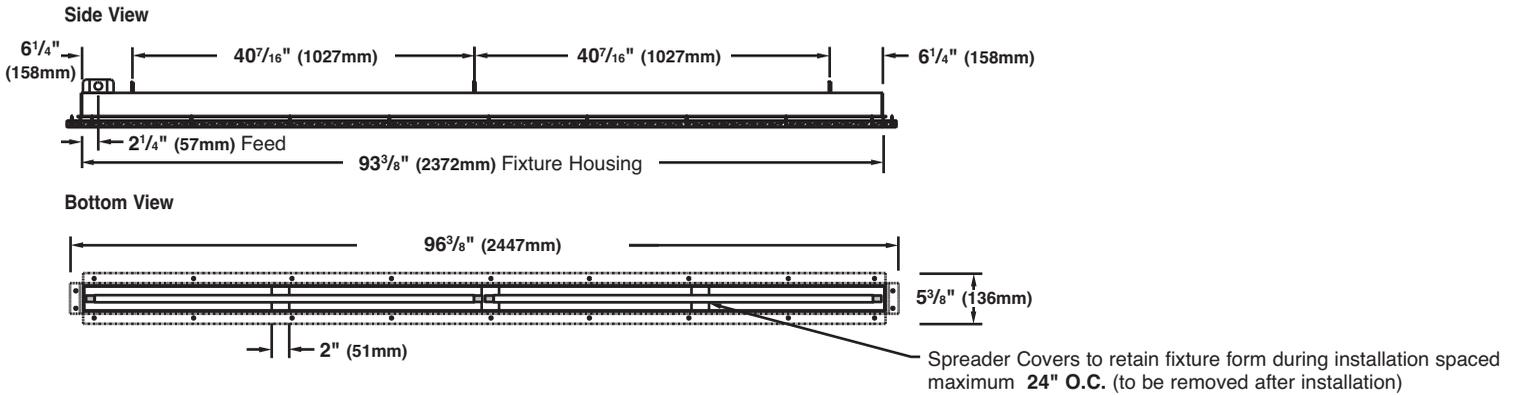

Nominal 12 foot Individual

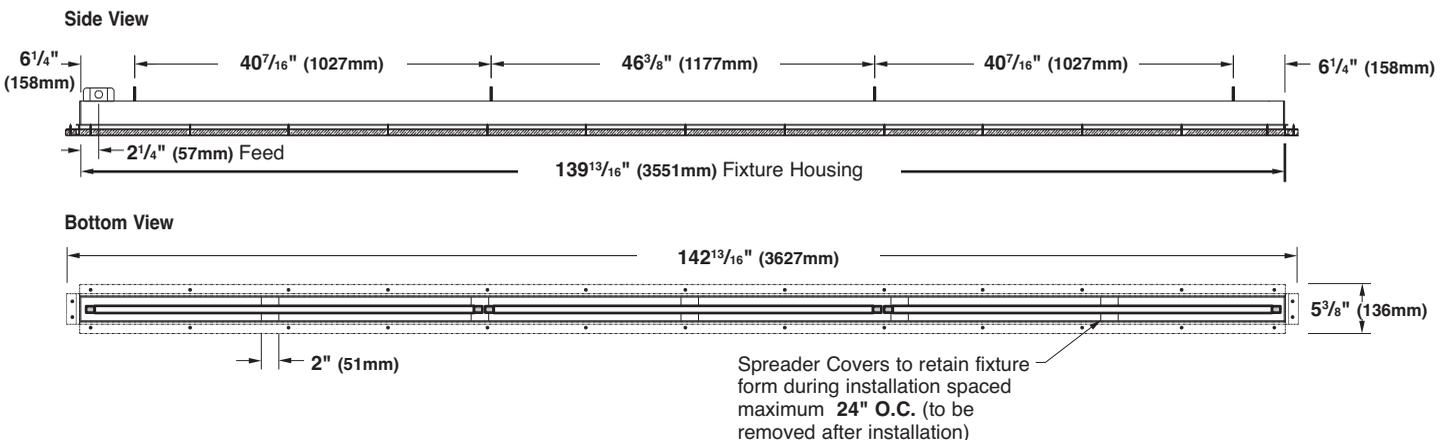

Fixture supplied with 7/8 knockout located 2 1/4" from end in top of fixture.

Fixtures must be intalled before sheetrock. For other lengths, lamping, continuous runs or configurations please specify overall length (in feet), accessories desired and sketch/drawing of configuration. Selux will detail project drawings upon order and supply submittal drawings for approval. Individual fixtures cannot be field joined. If you have any questions, contact Selux customer service or applications engineering for assistance (1-800-SELUX-CS).